

OWNER: _____


DATE DRILLED: _____

WELL #: _____

SWL: _____

County: _____

CONSOLIDATED WELLS AS BUILT DIAGRAM

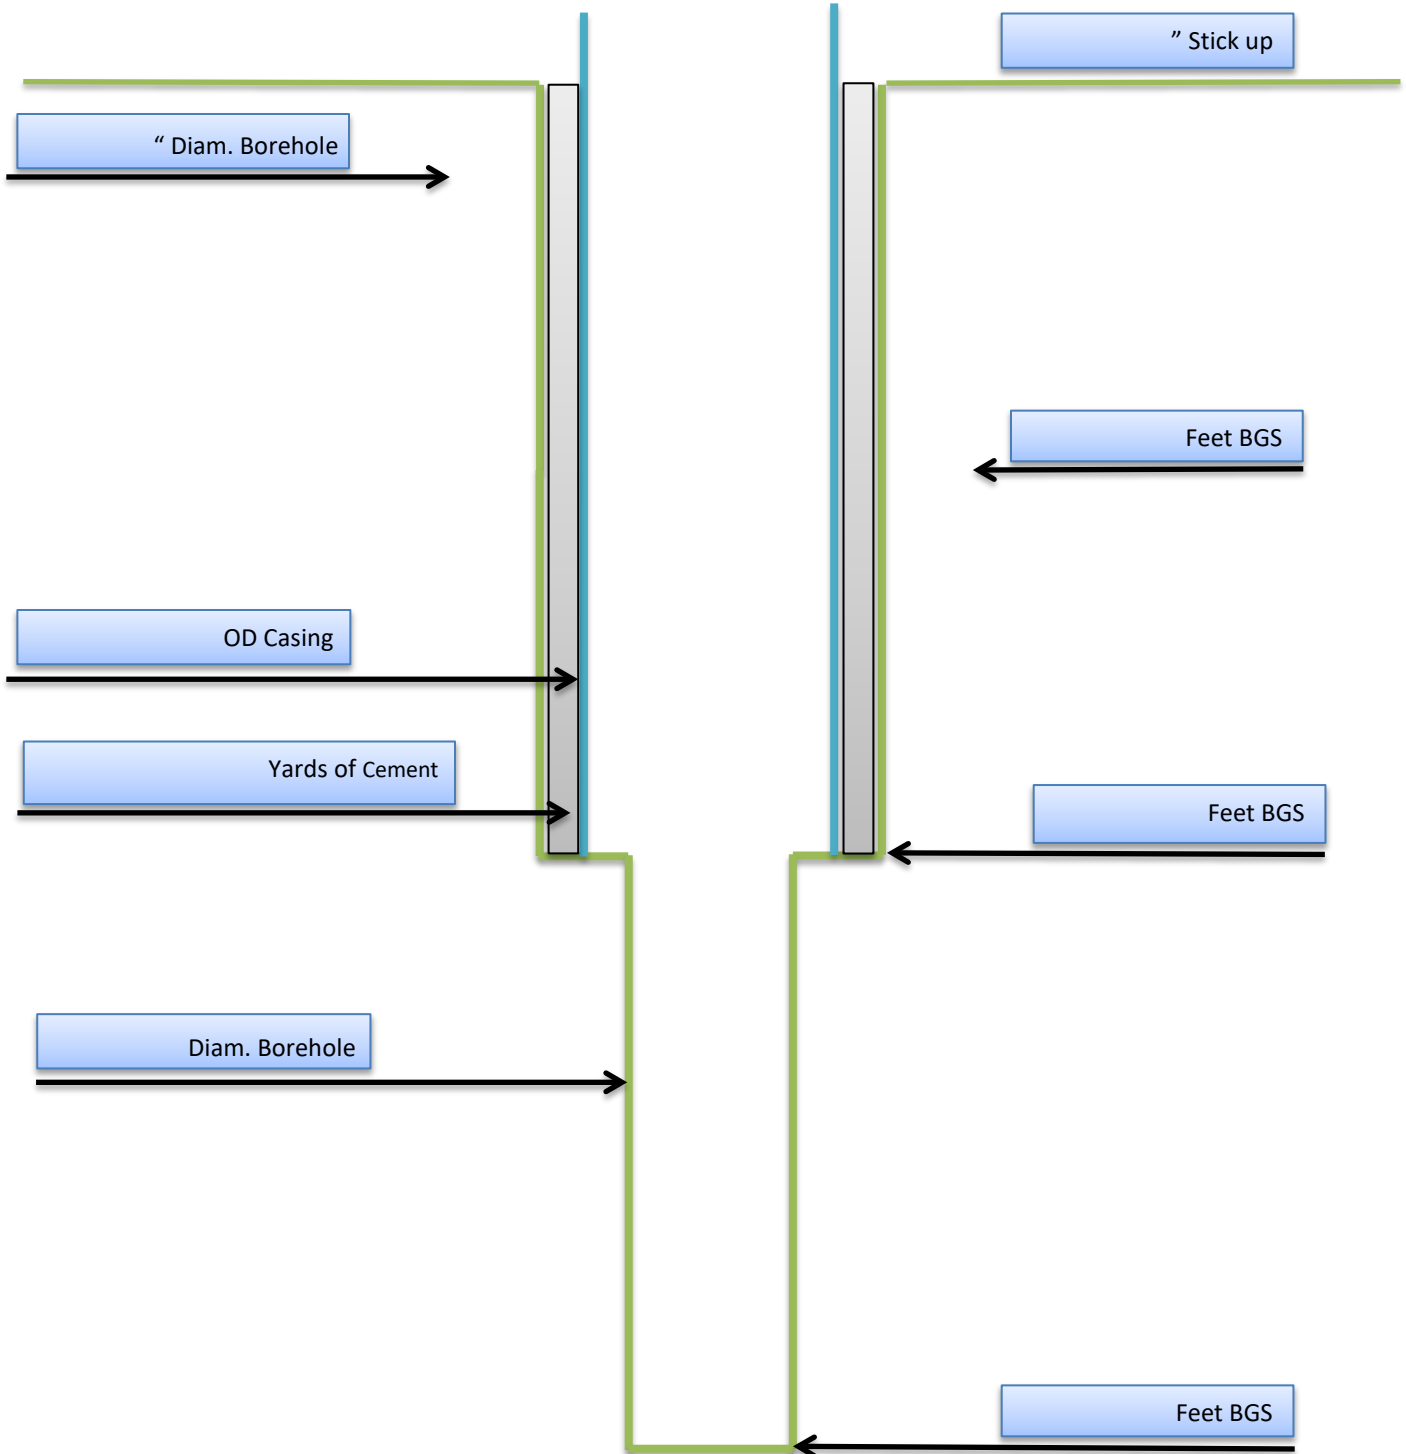

Great Lakes Water Resources Group, Inc.
1127 Plainfield Road
Joliet, IL 60435
815-210-6311 or 815-726-2720
www.glwrg.com



CLIENT: _____

WELL: _____

DATE STARTED: _____

DATE COMPLETED: _____

DRILLER/LIC: _____

COUNTY: _____

WELL DRILLING/BORING LOG

TOP	BOTTOM	WELL DRILLING – BORING LOG

NOTE: Test boring was Drilled Using Mud Rotary Method

Sincerely,

Kyle Brandenburg

Cell: 815-210-6311

E-Mail: kbrandenburg@glwrg.com

MUNICIPAL – INDUSTRIAL – IRRIGATION - ENVIRONMENTAL



Great Lakes Water Resources Group, Inc.
 1127 Plainfield Road
 Joliet, IL 60435
 815 - 726 - 2720

WELL TEST AND PUMP PERFORMANCE DATA SHEET

CLIENT: Oak Terrace
 WELL: Test Well
 DATE: 08-3-2022 - 08-4-2022

TESTED BY: Chad

PUMP MODEL: Grundfos 5-stage
 AIRLINE LENGTH: 314'

ORIFICE SIZE: 4x2 DIAMETER: 12"
 DEPTH OF WELL: 354' GL

MOTOR: Hitachi 25 HP 6" STATIC WATER LEVEL: 134'

GENERATOR USED: _____ Before other well was pumping 118'

AIRLINE READING
 PRIOR TO START UP

(SWL): 180' air gauge at start

STEP-RATE TEST: X CONSTANT RATE TEST: _____

PRE-TREATMENT: _____ POST-TREATMENT: _____

MEASUREMENT TAKEN FROM THE TOP OF THE WELL
 CASING, WHICH IS HOW MANY FEET FROM EXISTING
 GROUND FLOOR LEVEL?.....

BEGINNING TIME: 12:15 PM 08/03/22 END TIME: 10:30 AM 08/04/22

TIME	PIZOM READING	GPM	AIR GAUGE	PUMPING LEVEL	DRAW DOWN	DISCHARGE PSI FEET	SPEC CAP	AMPS A B C	COMMENTS/RTD
12:15 PM	15.5	59.5	152			60		Y 25 B 25	
12:16 PM			168			60		R 25	
12:17 PM			175			70		24 24 24	Dirty, milky Grey in color
12:18 PM	16	60.4	175			66			Dirty milky grey in color
12:19 PM	16	60.4	173			66		Yellow Black	24.7 24.5
12:20 PM	13	54.4	173			66		Red	24.6
12:21 PM	13	54.4	172			66		1 - 25 2 - 24 3 - 24	
12:22 PM	13	54.4	172			66			Clearing up Slight haze
12:23 PM	13	54.4	172	142	8	66			PH. 6.8
12:24 PM	12	52.3	172	142	8	66			
12:25 PM	12	52.3	172	142	8	66		1 - 25 2 - 24 3 - 24	
12:30 PM	12	52.3	172	142	8	66			Air gauge on school well is 70
12:35 PM	12	52.3	172	142	8	66			
12:40 PM	12	52.3	172	142	8	66		1 - 25 2 - 24 3 - 24	Cleaning up still slight haze
12:45 PM	12	52.3	172	142	8	66		1 - 25 2 - 24 3 - 24	
12:50 PM	12	52.3	172	142	8	66		1 - 25 2 - 24 3 - 23	Very little haze
12:55 PM	12	52.3	172	142	8	66			
1:00 PM	11.5	51.2	172	142	8	66		1 - 25 2 - 24 3 - 24	

TIME	READING	GPM	AIR GAUGE	LEVEL	DRAW DOWN	FEET	SPEC CAP	A B C	COMMENTS/RTD
1:05 PM	11.5	51.2	172	142	8	66			Air gauge still 70 on school well
1:10 PM	11.5	51.2	172	142	8	66			PH 6.9
1:15 PM	11.5	51.2	172	142	8	66		1 - 25 2 - 24 3 - 23	
1:20 PM	11.5	51.2	172	142	8	66			Water clear
1:30 PM	13	54.4	172	142	8	66			Air gauge at 75 on school well
1:40 PM	13	54.4	172	142	8	66		1 - 25 2 - 24 3 - 23	
1:50 PM	13	54.4	172	142	8	66			
2:00 PM	41	96.7	162	152	18	52		1 - 25 2 - 24 3 - 23	
2:01 PM	41	97.7	16.2	152	18	52			
2:02 PM	42	97.9	160	154	20	50			
2:03 PM	43	97.9	157	157	23	50		1 - 25 2 - 24 3 - 24	
2:04 PM	42	97.9	157	157	23	50			Water clear
2:05 PM	42	97.9	157	157	23	50			
2:06 PM	42	97.9	156	158	24	50			PH 6.9
2:07 PM	42	97.9	156	158	24	50			
2:08 PM	40	95.5	156	158	24	50			
2:09 PM	40	95.5	156	158	24	50			
2:10 PM	40	95.5	156	158	24	50			Air gauge a 70 on school well
2:15 PM	40	95.5	156	158	24	50		1 - 25 2 - 24 3 - 24	Water slight haze
2:20 PM	40	95.5	156	158	24	50			
2:25 PM	40	95.5	154	160	26	50			Water slight haze
2:30 PM	40	95.5	152	162	28	50		1 - 25 2 - 24 3 - 24	
2: 35 PM	38	93.1	152	162	28	50			
2:40 PM	40	95.5	152	162	28	50		1 - 25 2 - 23 3 - 23	Water still hazy
2:45 PM	40	95.5	152	162	28	50			
2:50 PM	38	93.1	152	162	28	50			Water very slight haze
2:55 PM	36.5	91.2	152	162	28	50			Air gauge at 70 at school well
3:00 PM	36.5	91.2	152	162	28	50			
3:05 PM	36.5	91.2	152	162	28	50			
3:10 PM	36.5	91.2	152	162	28	50			
3:15 PM	36.5	91.2	152	162	28	50	3.2	1 - 25 2 - 24 3 - 23	
3:30 PM	36.5	91.2	152	162	28	50	3.2	1 - 25 2 - 23 3 - 23	
3:45 PM	37.5	92.5	152	162	28	50	3.3	1 - 25 2 - 22 3 - 23	
4:00 PM	36.5	91.2	150	162	28	50		1 - 25 2 - 22 3 - 23	Air gauge at 65' at school well
4:15 PM	36.5	91.2	152	162	28	50		1 - 25 2 - 23 3 - 23	
4:30 PM	36.5	91.2	152	162	28			1 - 25 2 - 22 3 - 23	

TIME	READING	GPM	AIR GAUGE	LEVEL	DRAW DOWN	FEET	SPEC CAP	A B C	COMMENTS/RTD
4:45 PM	36.5	91.2	152	162	28	50		1 - 25 2 - 23 3 - 24	
5:00 PM	36.5	91.2	152	162	28	50		1 - 25 2 - 23 3 - 23	Air gauge at 65' at school well
5:15 PM	36.5	91.2	152	162	28	50		1 - 25 2 - 24 3 - 23	
5:30 PM	36.5	91.2	152	162	28	50		1 - 25 2 - 22 3 - 23	
5:31 PM	62	118.9	145	169	35	40		1 - 25 2 - 23 3 - 24	
5:32 PM	62	118.9	144	170	36	40		1 - 25 2 - 22 3 - 24	
5:33 PM	58	115.0	144	170	36	40		1 - 25 2 - 23 3 - 24	
5:34 PM	58	115.0	144	170	36	40		1 - 25 2 - 23 3 - 24	
5:35 PM	55	112.0	144	170	36	40		1 - 25 2 - 22 3 - 24	
5:36 PM	55	112.0	144	170	36	40		1 - 25 2 - 22 3 - 24	
5:37 PM	50	106	144	170	36	40		1 - 25 2 - 24 3 - 24	
5:38 PM	60	106	144	170	36	40		1 - 25 2 - 22 3 - 24	
5:39 PM	52	108.9	142	172	38	40		1 - 25 2 - 22 3 - 24	
5:40 PM	52	108.9	142	172	38	40		1 - 25 2 - 22 3 - 24	
5:45 PM	52	108.9	142	172	38	40		1 - 25 2 - 23 3 - 24	
5:50 PM	52	108.9	142	172	38	40		1 - 25 2 - 22 3 - 24	Air gauge is 65' in well be school
6:00 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 24	
6:05 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 24	
6:10 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 24	Water got dirty; cloudy, pumping fines
6:15 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 24	Cloudy, pumping fines
6:20 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 23	Cloudy, pumping fines
6:25 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 23	
6:30 PM	55	112.0	142	172	38	40		1 - 25 2 - 22 3 - 23	
6:35 PM						40			Shut down to change orifice plug
6:35 PM						40			From 2" to 2 1/2
6:40 PM						40			
6:45 PM						40			
6:50 PM	28.5	132.5	152	172	38	40		1 - 26 2 - 23 3 - 24	2 1/2 orifice plate
6:55 PM	24.0	121.6	148	172	38	40		1 - 26 2 - 23 3 - 24	
7:00 PM	24.0	121.6	148	172	38	40	3.2	1 - 26 2 - 23 3 - 24	
7:10 PM	21.5	115.1	143	171	37	40	3.1	1 - 25 2 - 24 3 - 23	
7:20 PM	22	116.4	143	171	37	40	3.1	1 - 25 2 - 23 3 - 24	
7:30 PM	22	116.4	143	171	37	40	3.1	1 - 25 2 - 23 3 - 24	
7:40 PM	22	116.4	143	171	37	40	3.1	1 - 25 2 - 23 3 - 24	
7:50 PM	22	116.4	143	171	37	40	3.1	1 - 25 2 - 23 3 - 24	

TIME	READING	GPM	AIR GAUGE	LEVEL	DRAW DOWN	FEET	SPEC CAP	A B C	COMMENTS/RTD
8:00 PM	22	116.4	143	171	37	40	3.1	1 - 25 2 - 22 3 - 23	Air gauge is 65 by the school
8:10 PM	22	116.4	143	171	37	40	3.1	1 - 25 2 - 23 3 - 22	
8:20 PM	22	116.4	142	172	38	40	3.0	1 - 25 2 - 23 3 - 25	
8:30 PM	22	116.4	142	172	38	40	3.0	1 - 25 2 - 23 3 - 25	
8:40 PM	22	116.4	142	172	38	40	3.0	1 - 25 2 - 23 3 - 25	
8:50 PM	22	116.4	142	172	38	40	3.0	1 - 25 2 - 23 3 - 25	
9:00 PM	22	116.4	141	173	39	40	2.9	1 - 25 2 - 23 3 - 25	
9:10 PM	22	116.4	141	173	39	40	2.9	1 - 25 2 - 24 3 - 25	
9:20 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 23 3 - 25	Air gauge is at 65 by school
9:30 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 24 3 - 25	
9:40 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 22 3 - 25	
9:50 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 22 3 - 25	
10:00 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 23 3 - 25	
10:10 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 22 3 - 25	
10:20 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 23 3 - 25	Air gauge is at 66 by school
10:30 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 23 3 - 25	
10:40 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 23 3 - 25	
10:50 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 24 3 - 25	
11:00 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 23 3 - 25	
11:10 PM	22	116.4	140	174	40	40	2.9	1 - 25 2 - 24 3 - 25	
11:20 PM	29.5	134.8	134	180	46	30	2.9	1 - 26 2 - 24 3 - 25	
11:21 PM	28	131.3	130	184	50	30	2.6	1 - 26 2 - 24 3 - 25	
11:22 PM	27.5	130.1	130	184	50	30	2.6	1 - 26 2 - 24 3 - 25	
11:23 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 25 3 - 25	
11:24 PM	27	139	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:25 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:26 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:27 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:28 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:29 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:30 PM	27	129	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
11:35 PM	27	129	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
11:40 PM	27	129	130	184	50	30	2.8	1 - 25 2 - 24 3 - 25	
11:45 PM	27	129	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
11:50 PM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	

TIME	READING	GPM	AIR GAUGE	LEVEL	DRAW DOWN	FEET	SPEC CAP	A B C	COMMENTS/RTD
11:55 PM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 26	
12:00 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 23 3 - 25	Air gauge is at 64 by school
12:05 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 23 3 - 25	
12:10 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
12:15 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 23 3 - 25	
12:20 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 23 3 - 25	
12:25 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
12:30 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 23 3 - 25	
12:35 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
12:40 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
12:45 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
12:50 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
12:55 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
1:00 AM	26	126.5	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
1:05 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
1:10 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
1:20 AM	26	126.5	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
1:30 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 23 3 - 25	
1:40 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
1:50 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
2:00 AM	25.5	125.3	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	Air gauge is at 64 by school
2:10 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 24 3 - 24	
2:20 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 24 3 - 24	
2:30 AM	25.5	125.3	131	183	49	30	2.5	1 - 26 2 - 24 3 - 25	
2:40 AM	25.5	125.3	131	183	49	30	2.5	1 - 26 2 - 24 3 - 25	
2:50 AM	25.5	125.3	131	183	49	30	2.5	1 - 25 2 - 23 3 - 25	
3:00 AM	28	131.3	132	182	48	30	2.7	1 - 25 2 - 23 3 - 25	Air gauge is at 64 by school
3:10 AM	28	131.3	132	182	48	30	2.7	1 - 26 2 - 24 3 - 25	
3:20 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	
3:30 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 23 3 - 25	
3:40 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 23 3 - 25	
3:50 AM	26.5	127.8	130	184	50	30	2.5	1 - 25 2 - 23 3 - 25	
4:00 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 24 3 - 25	Air gauge is at 64 by school
4:10 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 23 3 - 25	
4:20 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 23 3 - 25	

TIME	READING	GPM	AIR GAUGE	LEVEL	DRAW DOWN	FEET	SPEC CAP	A B C	COMMENTS/RTD
4:30 AM	26.5	127.8	130	184	50	30	2.5	1 - 26 2 - 23 3 - 25	
4:40 AM	25.5	125.3	131	183	49	30	2.5	1 - 26 2 - 23 3 - 25	
4:50 AM	25.5	125.3	131	183	49	50	2.5	1 - 26 2 - 23 3 - 25	
5:00 AM	25.5	125.3	131	183	49	50	2.5	1 - 26 2 - 23 3 - 25	
5:10 AM	25.5	125.3	131	183	49	30	2.5	1 - 25 2 - 23 3 - 25	
5:20 AM	25.5	125.3	131	183	49	30	2.5	1 - 25 2 - 23 3 - 25	
5:30 AM	25.5	125.3	131	183	49	30	2.5	1 - 25 2 - 23 3 - 25	
5:40 AM	25.5	125.3	131	183	49	30	2.5	1 - 26 2 - 24 3 - 25	
5:50 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
6:00 AM	25.5	125.3	130	184	50	30	2.5	1 - 25 2 - 24 3 - 25	
6:10 AM	44.5	165.6	115	199	65	10	2.5	1 - 26 2 - 25 3 - 26	
6:12 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 25 3 - 26	
6:13 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:14 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:15 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:16 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 25 3 - 26	
6:17 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 25 3 - 26	
6:18 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:19 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:20 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	Air gauge is 63 by school
6:25 AM	41	158.9	105	209	75	10	2.1	1 - 26 2 - 25 3 - 26	
6:30 AM	40.5	157.9	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:35 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
6:40 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 25 3 - 26	
6:45 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 25	
6:50 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 25 3 - 26	
6:55 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
7:00 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
7:05 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
7:10 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 25	
7:20 AM	40	157	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	Air gauge is 60 by school
7:30 AM	38.5	154	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
7:40 AM	38.5	154	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
7:50 AM	38.5	154	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	
8:00 AM	38.5	154	105	209	75	10	2.1	1 - 26 2 - 24 3 - 26	

TIME	READING	GPM	AIR GAUGE	LEVEL	DRAW DOWN	FEET	SPEC CAP	A B C	COMMENTS/RTD
8:10 AM	38	153	105	209	75	10	2.1	1-26 2-24 3-25	
8:20 AM	38	153	105	209	75	110	2.1	1-26 2-24 3-25	
8:30 AM	38	153	105	209	75	10	2.1	1-26 2-24 3-25	
8:40 AM	38	153	105	209	75	10	2.1	1-26 2-24 3-25	
8:50 AM	38	153	104	210	76	10	2.0	1-26 2-24 3-25	
9:00 AM	38	153	104	210	76	10	2.0	1-26 2-24 3-25	Air gauge is 56 by school
9:10 AM	38	153	105	209	75	10	2.1	1-26 2-24 3-25	
9:20 AM	38	153	105	209	75	10	2.1	1-26 2-24 3-25	
9:30 AM	38	153	105	209	75	10	2.1	1-25 2-24 3-26	
9:40 AM	38	153	105	209	75	10	2.1	1-26 2-25 3-24	
9:50 AM	38	153	105	209	75	10	2.1	1-26 2-23 3-25	Air gauge is 54 by school
10:00 AM	38	153	105	209	75	10	2.1	1-26 2-23 3-25	
10:10 AM	7	65.7	150	164	30	50	2.1	1-26 2-23 3-25	
10:20 AM	7	65.7	150	164	30	50	2.1	1-26 2-24 3-25	
10:30 AM	7	65.7	150	164	30	50	2.1	1-26 2-24 3-26	



Great Lakes Water Resources Group, Inc.
 1127 Plainfield Road
 Joliet, IL 60435
 815 - 726 - 2720

WELL TEST AND PUMP PERFORMANCE DATA SHEET

CLIENT: Oak Terrace
 WELL: Test Well - Recovery
 DATE: 08-4-22-PostTest Pumping - Recovery Test

TESTED BY: Chad

PUMP MODEL: Grundfos 5-stage
 AIRLINE LENGTH: 314'

ORIFICE SIZE: 4x2 DIAMETER: 12"
 DEPTH OF WELL: 354' GL

MOTOR: Hitachi 25 HP 6" STATIC WATER LEVEL: 134'

GENERATOR USED: _____ Before other well was pumping 118'

AIRLINE READING
 PRIOR TO START UP

(SWL): 180' air gauge at start
 STEP-RATE TEST: X CONSTANT RATE TEST: _____
 PRE-TREATMENT: _____ POST-TREATMENT: _____

MEASUREMENT TAKEN FROM THE TOP OF THE WELL
 CASING, WHICH IS HOW MANY FEET FROM EXISTING
 GROUND FLOOR LEVEL?.....

BEGINNING TIME: 10:40 AM 08/04/22 END TIME: 12:15 PM 08/04/22

TIME	PIZOM READING	GPM	AIR GAUGE	PUMPING LEVEL	DRAW DOWN	DISCHARGE PSI FEET	SPEC CAP	AMPS A B C	COMMENTS/RTD
10:30 AM	7	65.7	150	164	30	50	2.1	1 - 26 2 - 24 3 - 26	
10:40 AM	7	65.7	150	164	30	50	2.1		
10:42 AM	SHUT	DOWN	PUMP	↓	STATIC	OVERLOAD			Recovery Test
10:45 AM			156	158	24				
10:50 AM			162	152	18				
10:55 AM			170	144	10				
11:00 AM			173	141	7				
11:05 AM			174	140	6				
11:10 AM			176	138	4				
11:15 AM			176	138	4				
11:20 AM			177	137	3				
11:25 AM			177	137	3				
11:30 AM			177	137	3				
11:35 AM			178						
11:40 AM			178						
11:45 AM			178						
12:00 PM			178						
12:15 PM			178						